TYPICAL CONTROL POINT

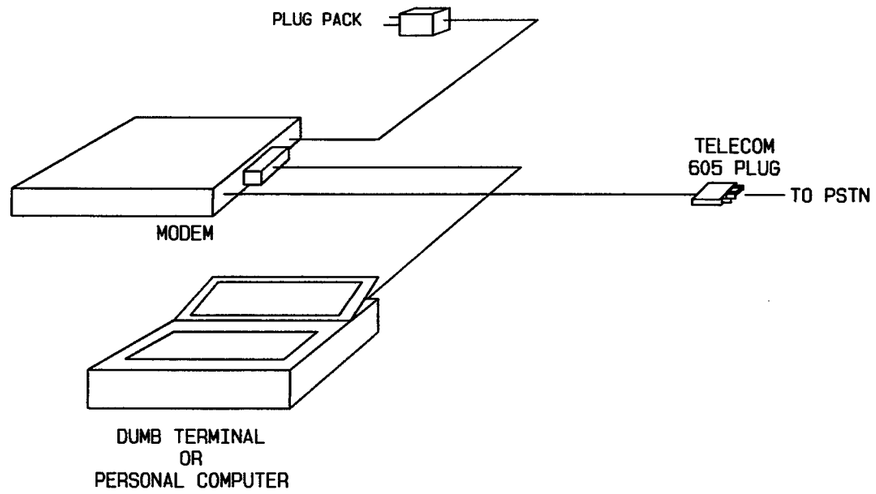

TYPICAL BASE INSTALLATION

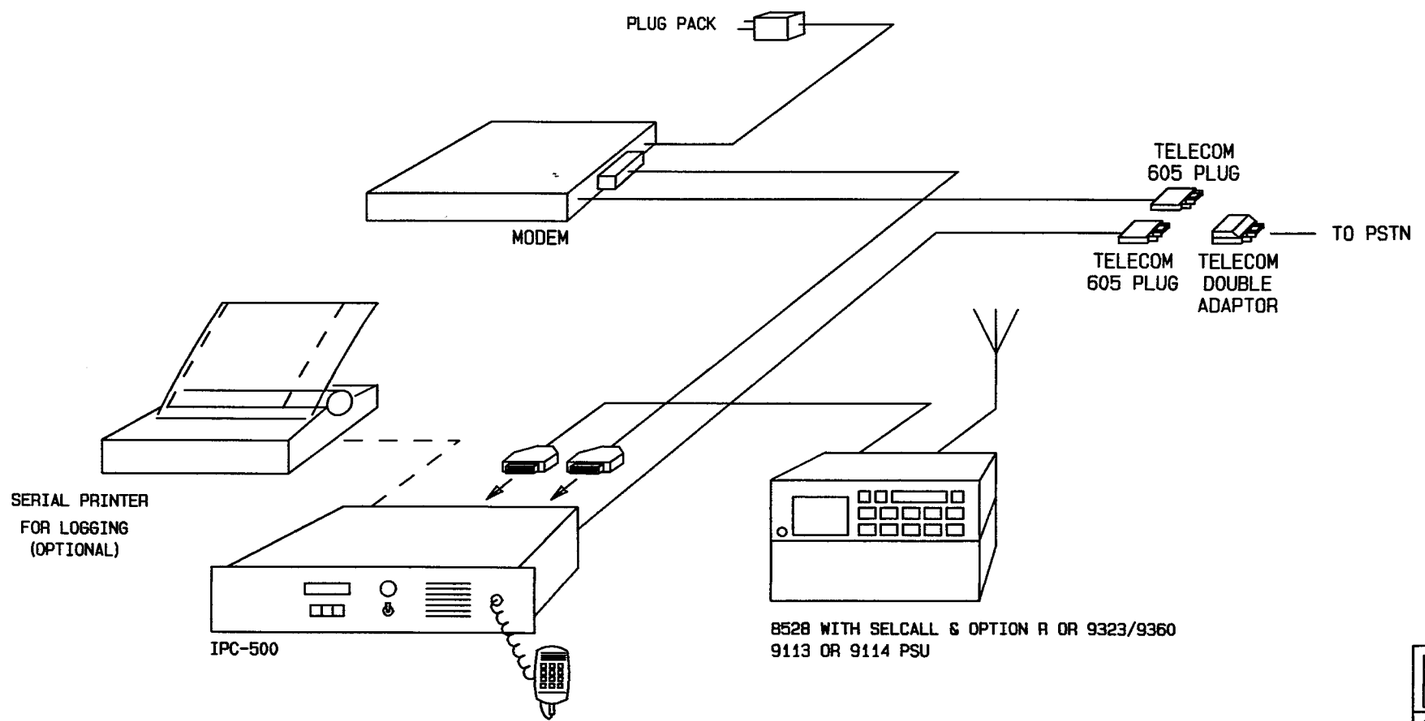

ISSUE 1:
C/R 24181
PSU WAS 8540B
IBW 15-02-95

ISSUE 2
C/R 24534
9323.. NOTES
ADDED TO PSU.
AMT 13-03-96

DISC FILE
00894__2.SCH

CODAN

			SCALE
	DRN	C G	DATE 27-7-93
MATERIAL	CHKD	IBW	30-7-93
	APPD	IBW	15-2-95
FINISH	TOLERANCES UNLESS OTHERWISE STATED 2 PLACES DEC. ± 1 PLACE DEC. ± ANGULAR ±		

COPYRIGHT © CODAN PTY. LTD. A.C.N. 007 590 605

TITLE
REMOTE PROGRAMMING
CONFIGURATION

A3 DRAWING/DOC.NO 03-00894

ISS A 1 2 SHT 1 OF 1